


IN PAVED AREAS

LANDSCAPED OR UNIMPROVED AREAS

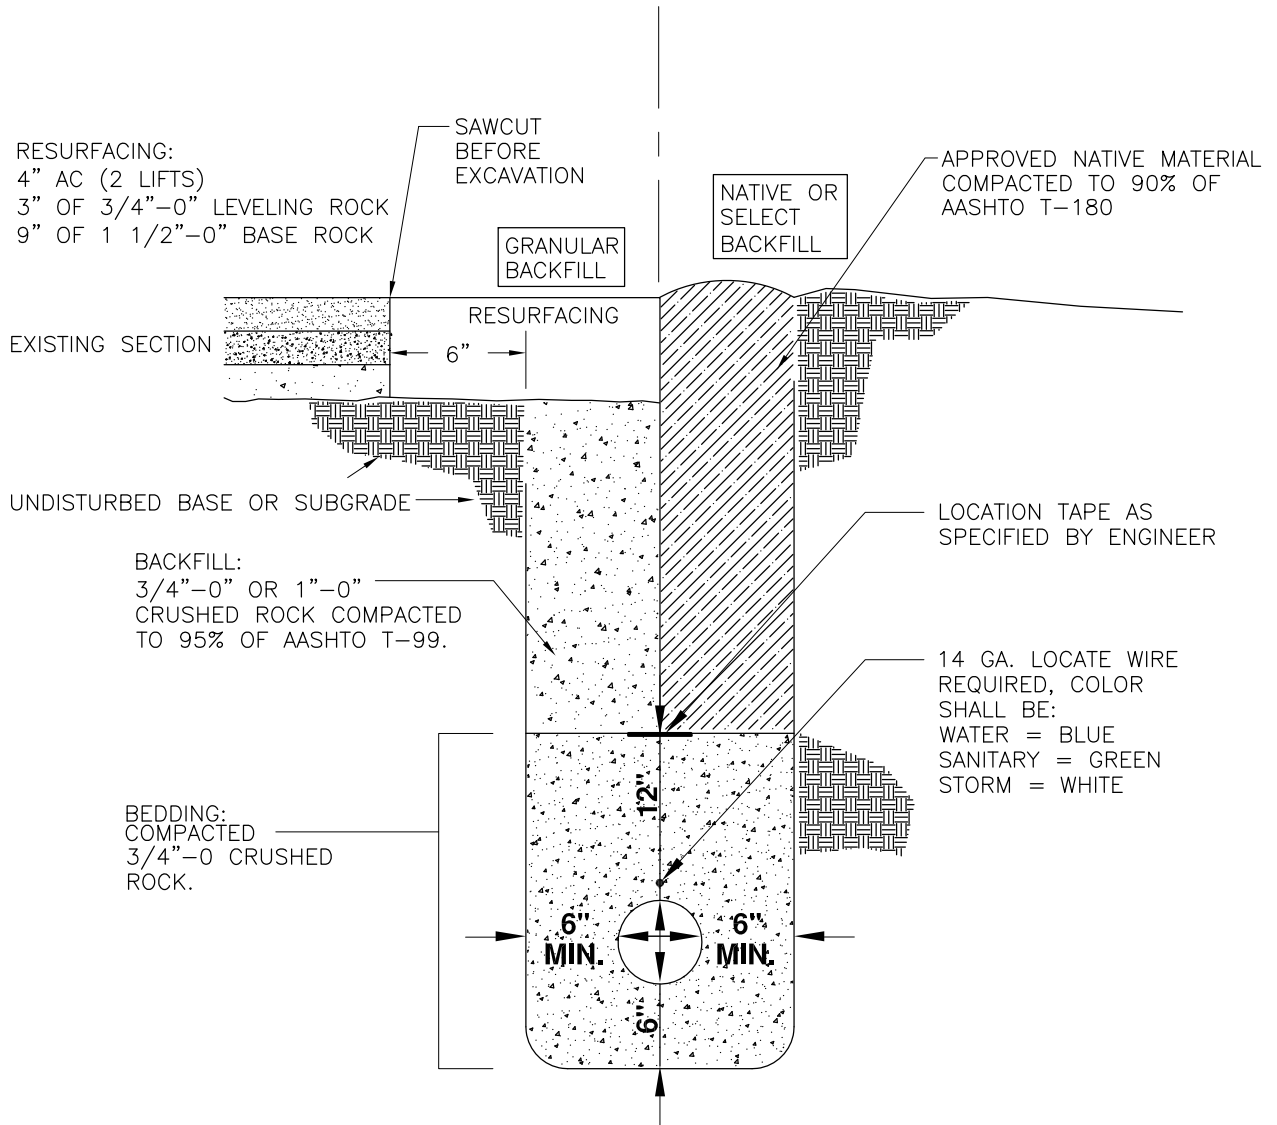

NOTE:

1. CONTRACTOR SHALL TACK EDGES OF TRENCH AND PLACE AND COMPACT ASPHALT IN ACCORDANCE WITH ODOT STANDARD SPECIFICATIONS.
2. REPLACE CONCRETE ROADWAY AS ENCOUNTERED, EQUIVALENT SECTION. CONCRETE TO BE CLASS 3300, 1 1/2" MAX AGGREGATE.
3. IN ROADWAY SHOULDERS AND GRAVEL DRIVEWAYS IN RIGHT-OF-WAY USE GRANULAR BACKFILL AND SURFACE WITH 6" OF 3/4"-0" CRUSHED ROCK.



**City of Astoria**  
**Public Works Department**  
 1095 Duane Street

**Utility Trench Detail**

Date Adopt. 11/01/12      Date Rev. 11/20/15

Dwg. Name: UT-1 Utility Trench.dwg

DWG. NO.

**UT-1**